


REVISIONS				
REV	ZONE	DESCRIPTION	DATE	APPROVED
1	1A	ADDED NOTE 1 REGARDING UNION.	09/27/13	S.P.

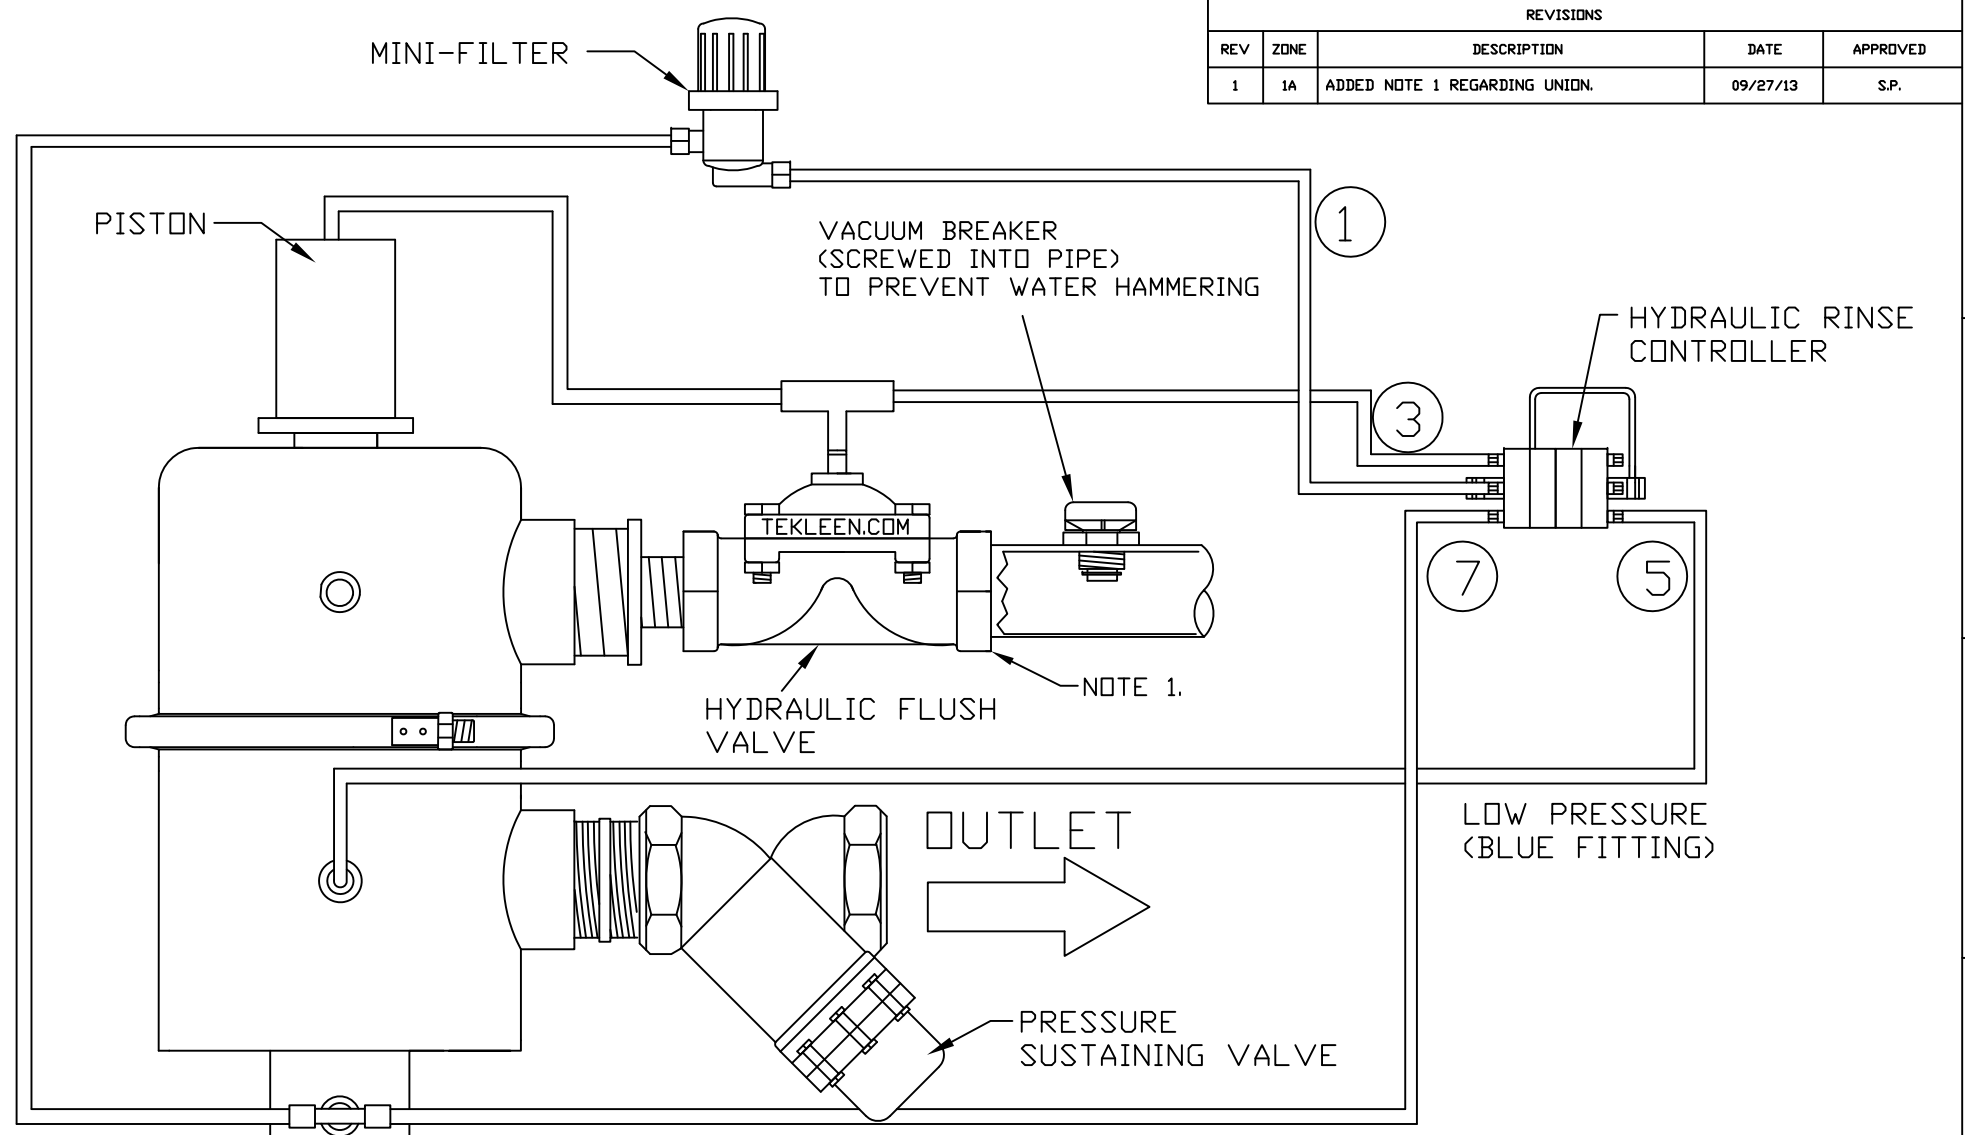

NOTES:
 1. IT IS RECOMMENDED THAT A UNION BE INSTALLED BETWEEN THE FLUSH VALVE AND FLUSH LINE FOR EASE OF MAINTENANCE.

UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES DECIMALS ANGULAR .XX ± .05 ± 0.5 DEG. .XXX ± .01		AUTOMATIC FILTERS, INC. 2672 S. LA CIENEGA BLVD. LOS ANGELES, CA 90034 (310) 839-2828 FAX (310) 839-6878		
DRAWN S. PERKINSON		DATE 10/03/11		TITLE MTF FILTER WITH HYDRAULIC RINSE CONTROLLER, HYDRAULIC FLUSH VALVE & PRESSURE SUSTAINING VALVE
CHECKED		SIZE A	DWG NO. WIRE-MTF-HFV-LAY-01	REV 1
DESIGN		NOT TO SCALE		SHEET 1 OF 1